


Luminaire Schedule						
Symbol	Qty	Label	Description	Lum. Watts	LLF	Lum. Lumens
→	13	WL	MO13HL-PP-MW-8L40K-DCC-DV	11.47	0.900	963
→	2	A	MRM-LED-07L-SIL-2-30-70CRI-IL	53	0.880	4167
→	6	B	MRM-LED-07L-SIL-3-30-70CRI-IL	53	0.880	5050
→	13	C	MRM-LED-07L-SIL-3-30-70CRI	53	0.880	6889
→	66	D	MRB-LED-25L-ACR-A-30	23	0.930	1633
→	12	E	MRB-LED-25L-ACR-S-30	30	0.930	2156

Calculation Summary						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Back Sidewalk	Fc	6.51	18.2	0.3	21.70	60.67
Backside Landscape	Fc	0.53	13.6	0.0	N.A.	N.A.
Main Entrance Sidewalk1	Fc	3.15	19.0	0.0	N.A.	N.A.
Main Entrances Driveway	Fc	3.51	24.1	0.3	11.70	80.33
Property line	Fc	0.60	7.9	0.0	N.A.	N.A.
Tower A Service Entry Road	Fc	2.30	5.1	0.8	2.88	6.38
Tower A Service Road Side Walk	Fc	2.14	14.0	0.5	4.28	28.00
Tower B Service Entry Road	Fc	2.85	5.9	0.2	14.25	29.50
Tower B Service Road Side Walk	Fc	1.84	2.6	0.8	2.30	3.25

NOTES
 1. REFER TO LAYOUT FOR LUMINAIRE MOUNTING HEIGHT
 2. FULL LUMINAIRE MOUNTING HEIGHT IS 1/2" OF AFC (1" FOR A AND 3" BARD)
 3. CALCULATION GRID ARE AT GRADE LEVEL

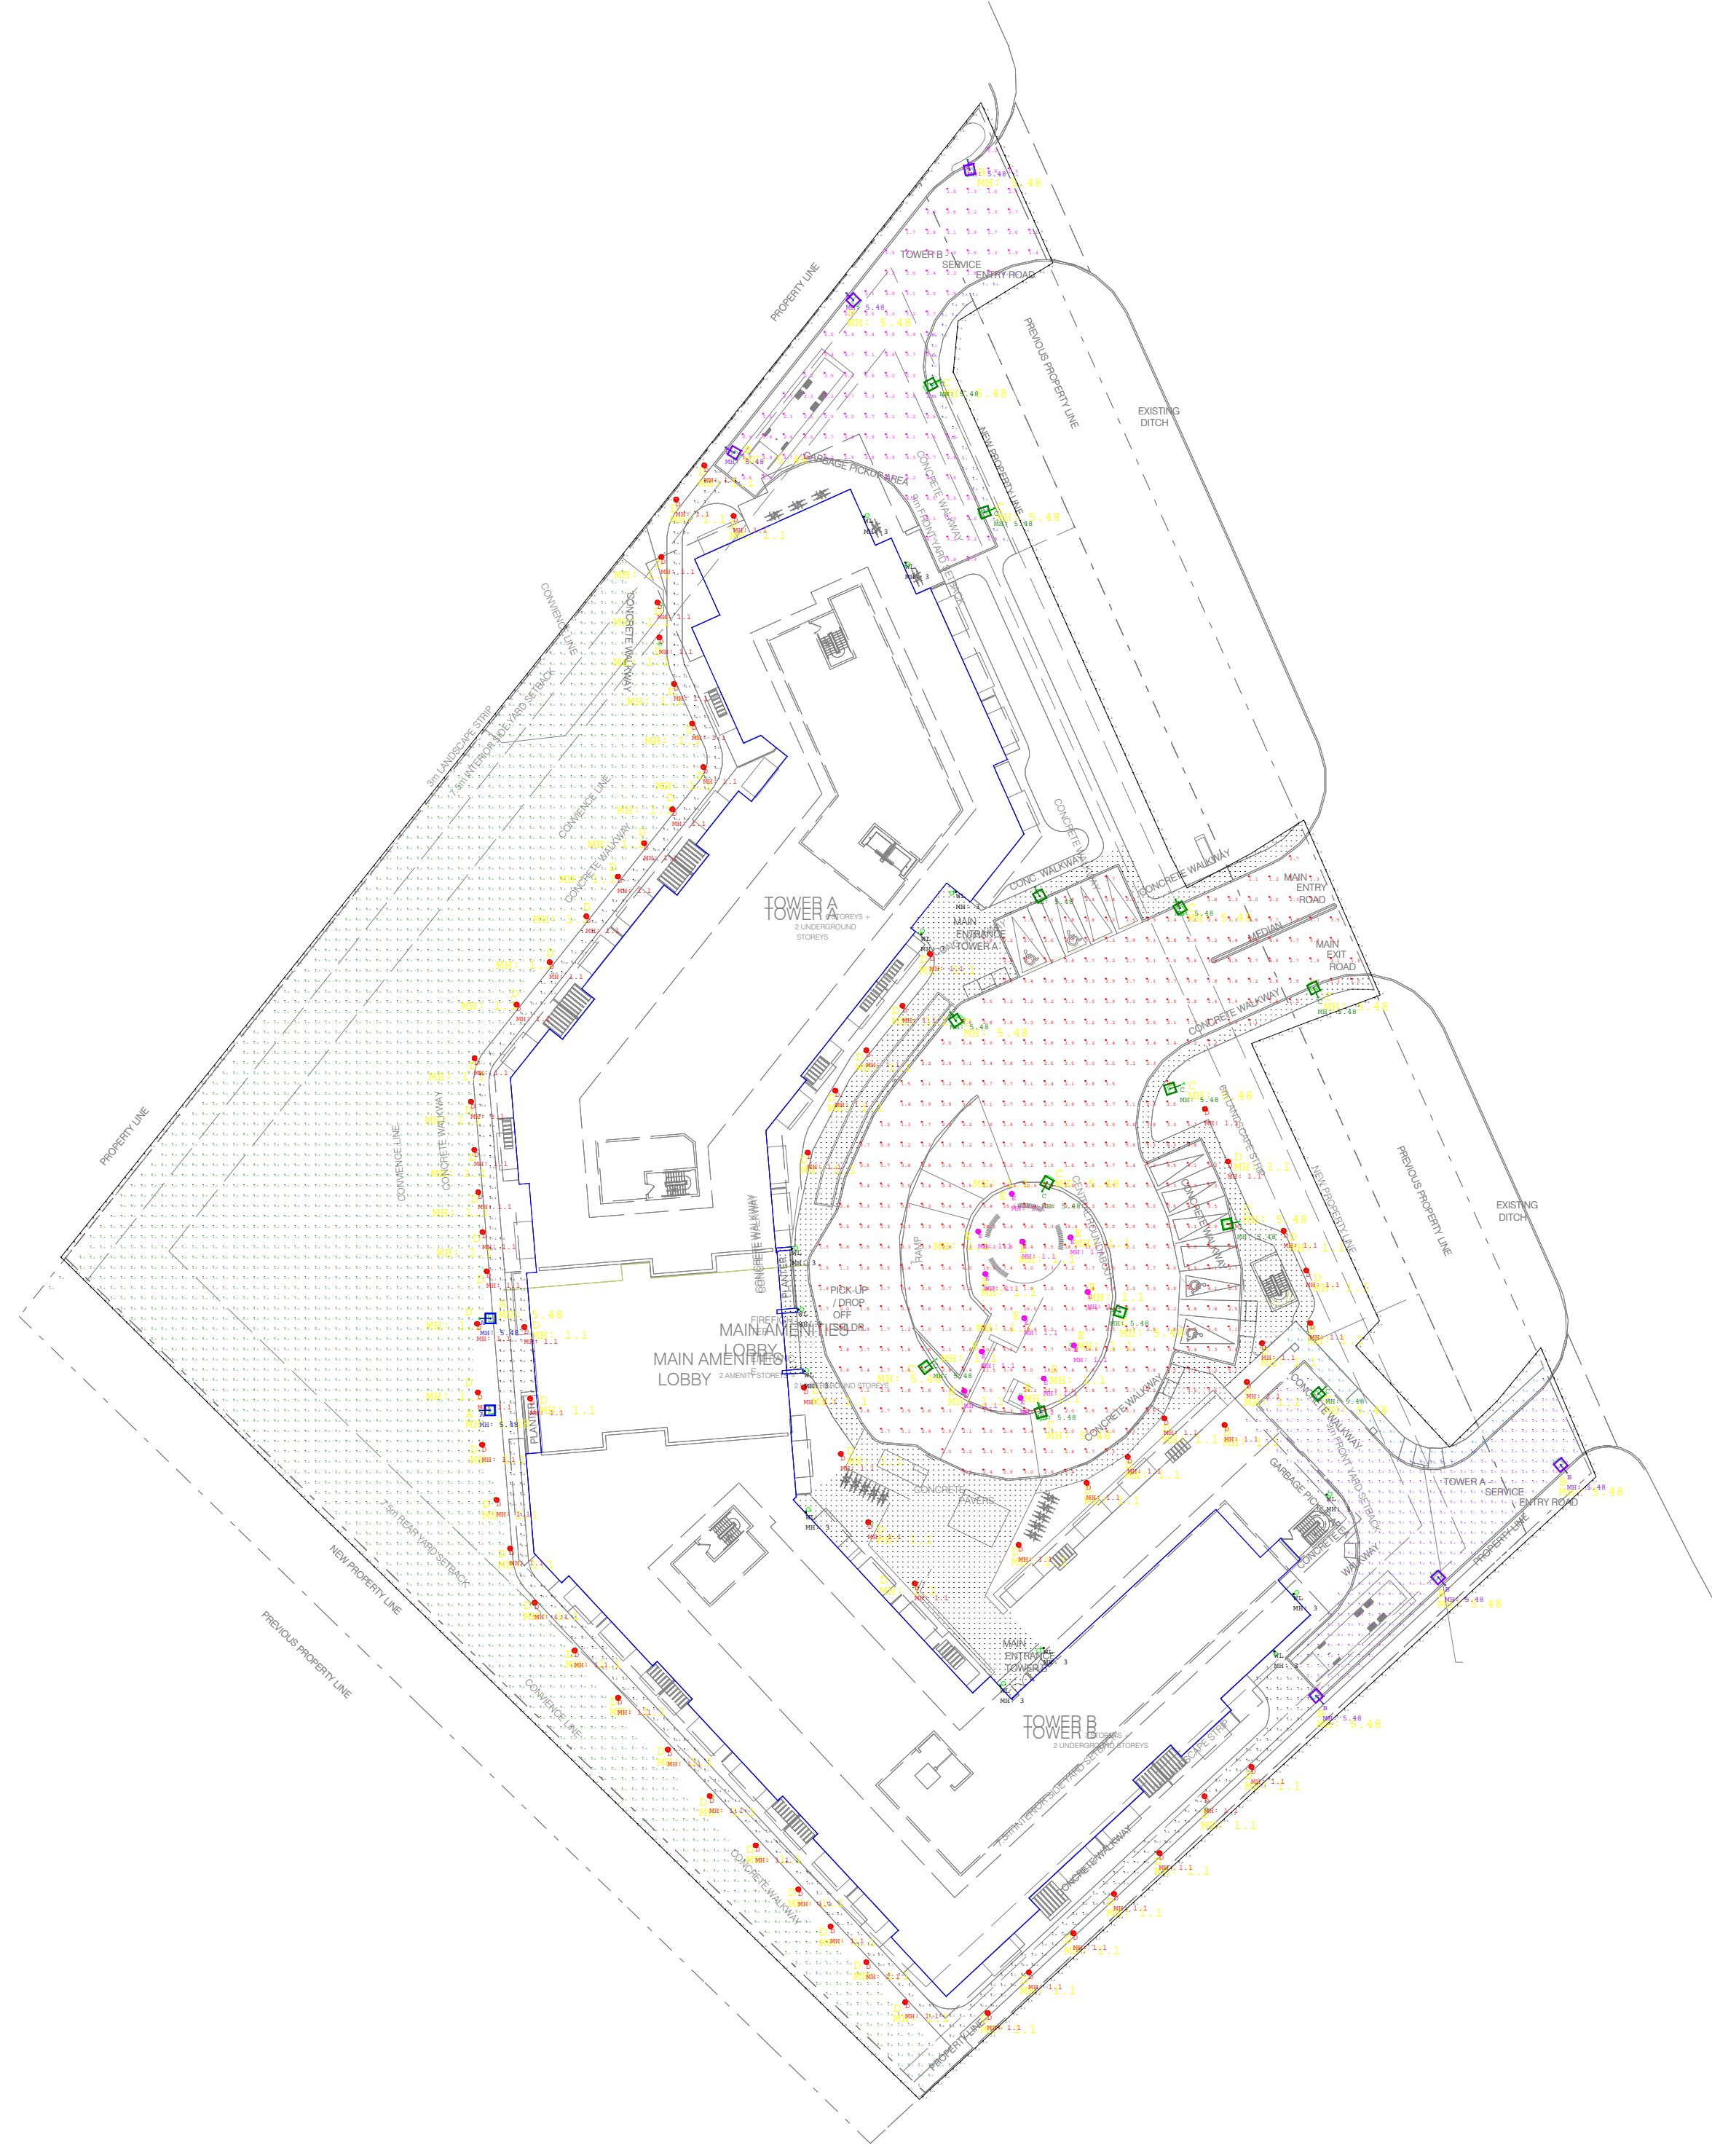

Site PLAN
 2023-01-18

TOWN OF CALEDON
 PLANNING
 RECEIVED
 May 1, 2023

Rutenberg Sales

Revisions	
#	Comments

Prepared By: K.S	Not Per Scale
Checked By: RAFAEL AHMAD	
Date: 2023-01-18	

Proposed Mix-Used Condo
 Development - 12148 Albion
 Vaughan Rd Bolton