



GENERAL INFORMATION:


PROJECT ID | 1527SS
CLIENT NAME | **Deven Verma**
BUILDING ADDRESS | **15-27 Shore Street**
 | **Caledon, Ontario**

TESTED BY: AA
DATE | **June 21-24**
TIME | **1:30:00 PM**

WATER MAIN INFORMATION:

MAIN SIZE / MATERIAL | **NA**
CONFIGURATION | **Looped**

HYDRANT LOCATION:

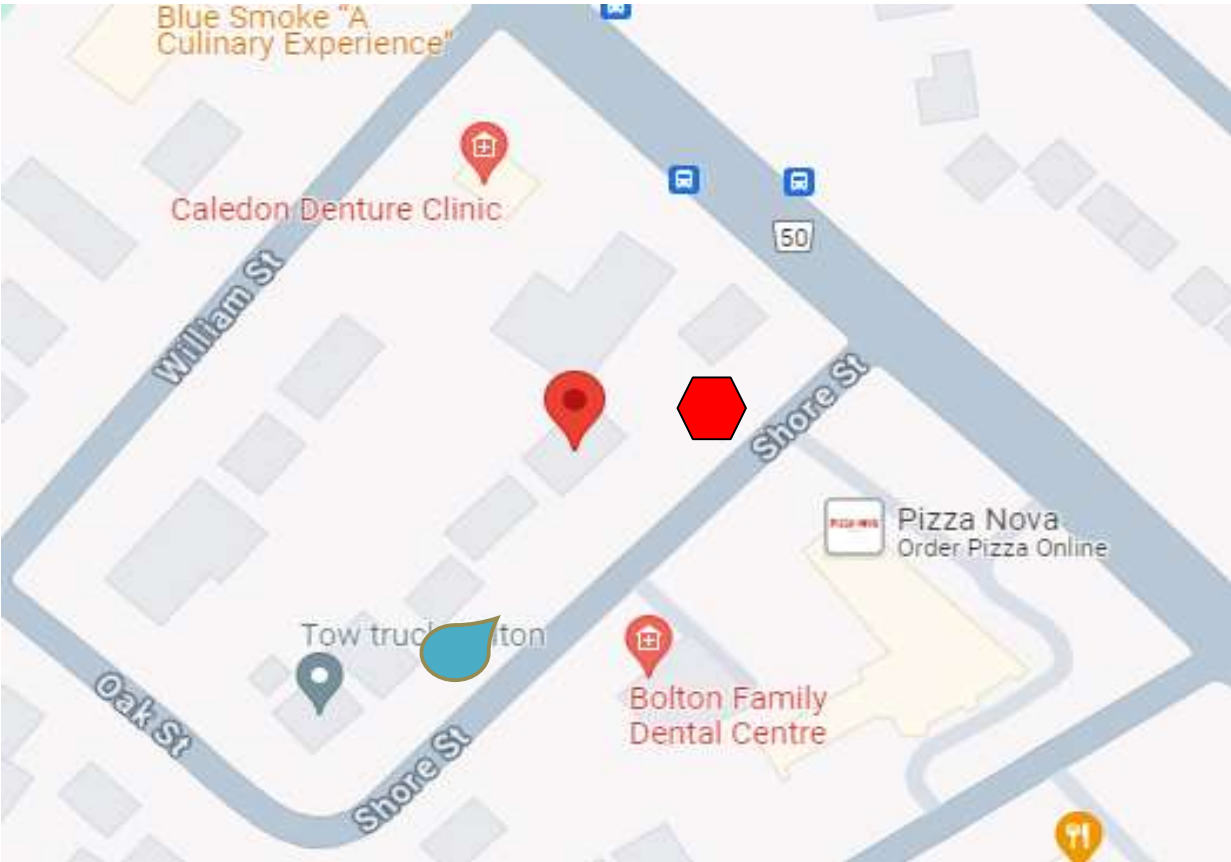

LEGEND:




STATIC HYDRANT



RESIDUAL HYDRANT

FINAL RESULTS:

Test #	Number of Outlets	Orifice Size (in)	Pitot Reading (psig)	Equivlnt Flow (usgpm)	Total Flow (usgpm)	Projected flow at 20psi (usgpm)	Gauge Pressure (psig)	Discharge Coef'nt
Static	N/A	N/A	N/A	N/A	0	N/A	58	N/A
1	1	2.47	34	849	849	4163	56	0.8
2	2	2.47	22	683	1366	3700	52	0.8

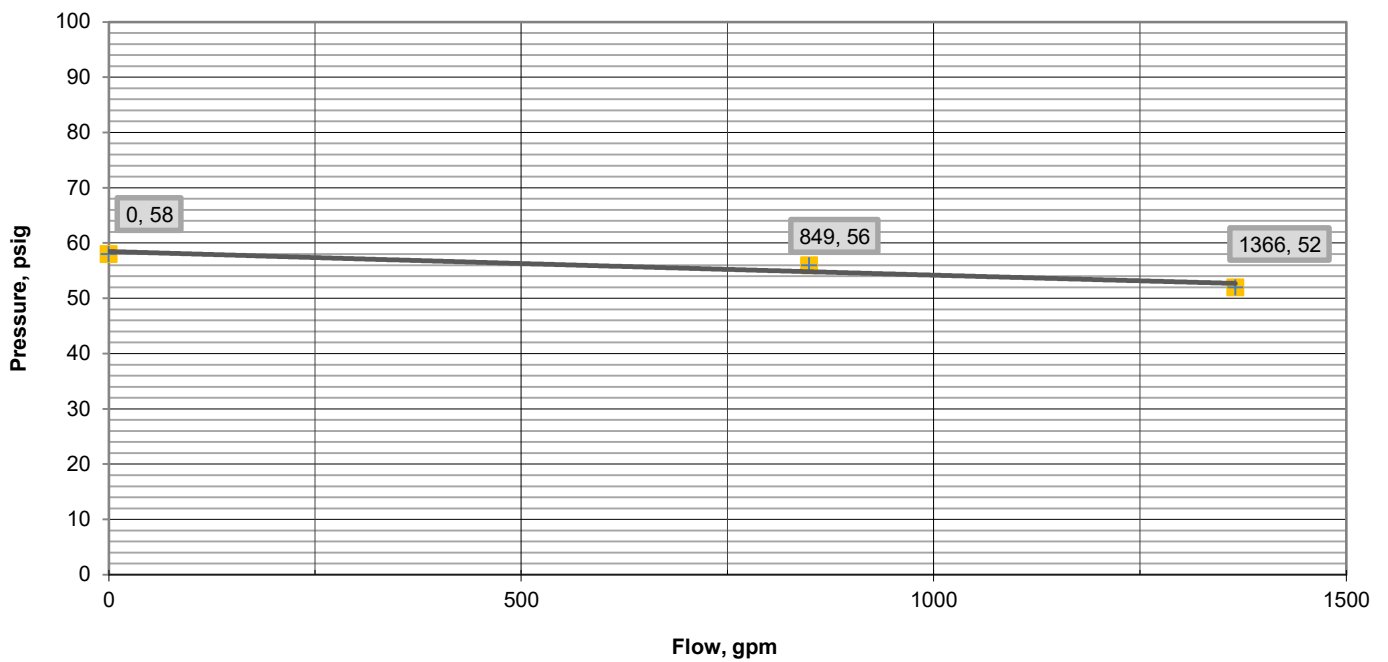

Note: Report is in accordance with applicable bylaw standards and NFPA 291 Recommended Practice for Water Flow Testing and Marking of Hydrants